




PADMOUNT SUBSTATION & SWITCHING STATION CLEARANCES

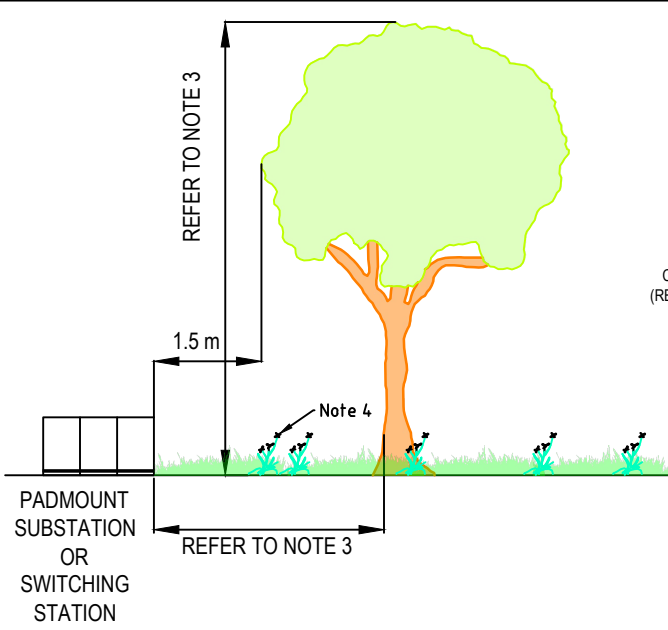


PADMOUNT SUBSTATION OR SWITCHING STATION

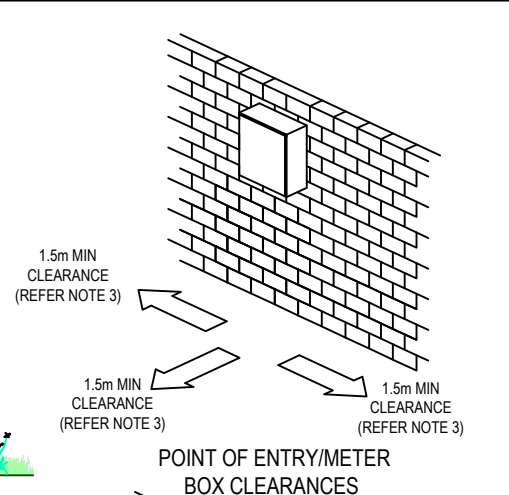


POINT OF ENTRY/METER BOX CLEARANCES

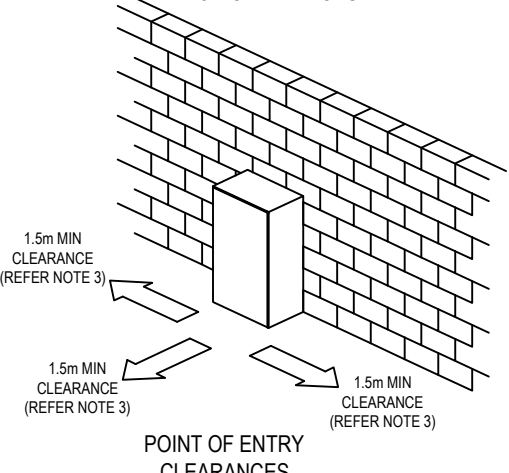


POINT OF ENTRY CLEARANCES

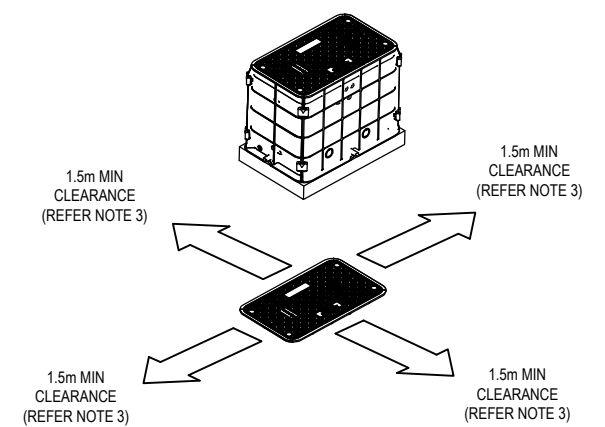

LV PIT CLEARANCES

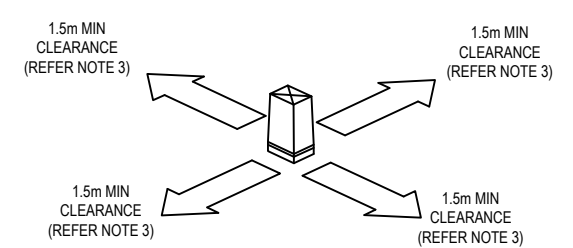


LV PILLAR CLEARANCES

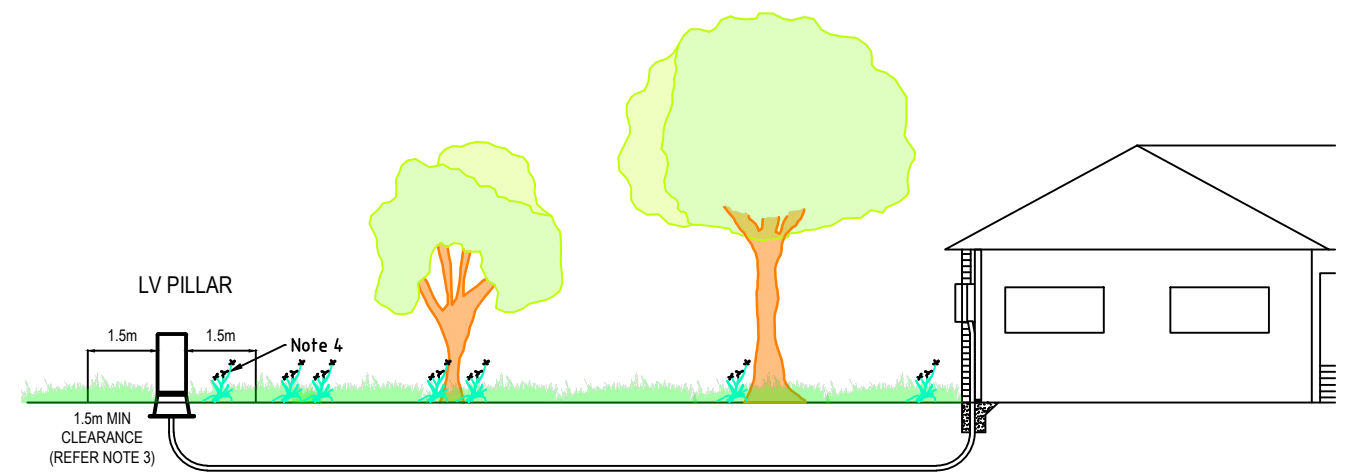

LV PILLAR

- NOTES:**
- BRANCHES & TREE GROWTH MUST NOT OVERHANG THE ASSET CLEARANCES AS SHOWN ON THIS DRAWING, AND, TREES MUST BE MAINTAINED SO THAT THEY CAN NOT FALL ON TO OR DROP BRANCHES ON ABOVE GROUND NETWORK ASSETS. MAINTAINED/PRUNED LAWN AND GRASS IS ACCEPTABLE.
 - ALL PRUNING MUST COMPLY WITH AS4373 PRUNING OF AMENITY TREE STANDARD.
 - 1.5m ASSET CLEARANCE AS SHOWN ON THIS DRAWING IS CONSIDERED AS NO TREE ZONE THAT IS 1.3m CLEARANCE SPACE + 0.2M REGROWTH ALLOWANCE/BUFFER ZONE.
 - WELL MAINTAINED GRASS AND SHRUBS UP TO 1m HEIGHT ARE ALLOWED IN NO TREE ZONE.

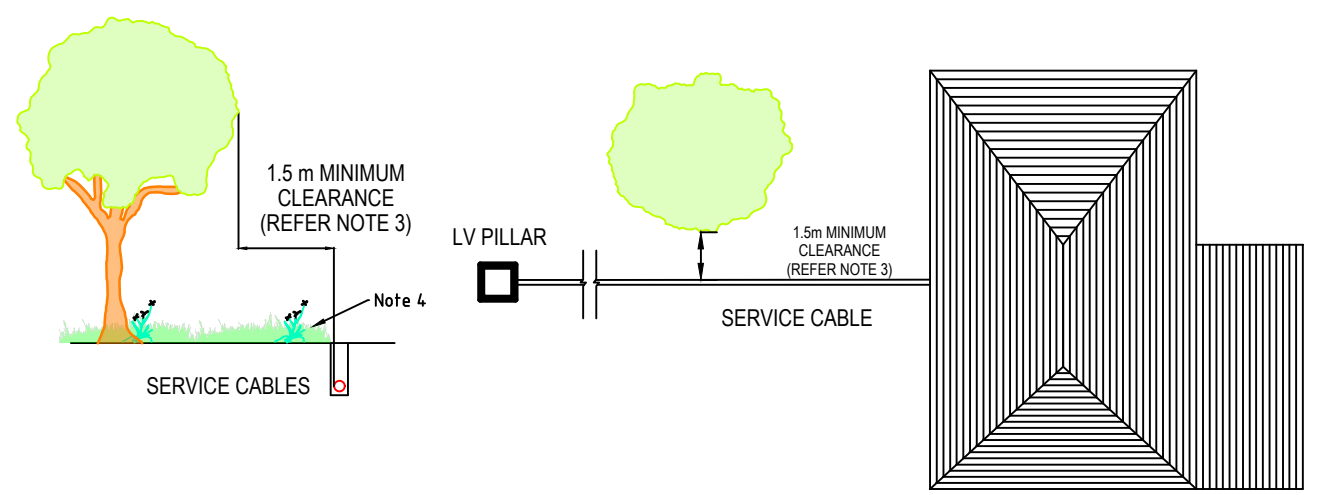

SERVICE CABLES

				Drawn: K. Vedanti	Designed: K. Vedanti	evoenergy VEGETATION CLEARANCE REQUIREMENTS FOR EVOENERGY GROUND ASSETS IN ACT AND NSW	Scale: N.T.S	Date: 28/06/2022	Sheet No:	
				Checked: N. Azizi	28/06/2022		Work Pack No:	File:		
				Approved: W. Cleland	28/06/2022		Status:	Current		
				Project No:			A3		Rev A	
The information contained within this drawing & associated electronic file shall remain the property of Evoenergy and shall not be copied or used for any other purpose without express written permission from Evoenergy. © Evoenergy. 2018.				ACT Cadastral information supplied by the ACT Environment & Sustainable Development Directorate. © ACT Gov. 2018.				3811-015		