


- NOTES:**
1. THE SERVICE LEAD-IN CONDUITS EXTEND 1 METRE FROM THE REAR OF EACH PIT INTO EACH OF THE BLOCKS OF WHICH THE PIT SPANS THE SIDE BOUNDARY AT A DEPTH OF 600MM. THIS IS THE CONNECTION POINT FOR CONDUIT TO HOUSE METER BOX.
  2. THE BLOCK OWNER'S LICENSED ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR INSTALLING THE CONDUIT BETWEEN THE SERVICE LEAD-IN CONDUIT AND THE METER BOX. THIS INSTALLATION SHALL BE COMPLIANT WITH THE EVOENERGY SERVICE AND INSTALLATION RULES SM 11144 AND AS 3000.
  3. SERVICE CABLE SHALL BE INSTALLED AND TERMINATED IN BOTH THE SERVICE PIT AND METER BOX BY EVOENERGY STAFF.
  4. SERVICES SHALL BE INSTALLED IN A SINGLE PHASE ARRANGEMENT UNLESS EVOENERGY HAS AGREED TO A THREE PHASE ARRANGEMENT AS PER THE SERVICE AND INSTALLATION RULES SM 11144.
  5. SEALED LUGS AND THE SPECIFIED HEATSHRINK MUST BE USED FOR ALL PHASE AND NEUTRAL TERMINATIONS.
  6. SERVICE CABLES MUST BE CAPPED AND WATERTIGHT AT BOTH ENDS IF NOT BEING TERMINATED AT TIME OF INSTALLATION.
  7. EARTHING SYSTEM MUST BE INSTALLED IN VERGE AND NOT WITHIN A RESIDENTIAL BLOCK BOUNDARY.
  8. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE SHOWN.

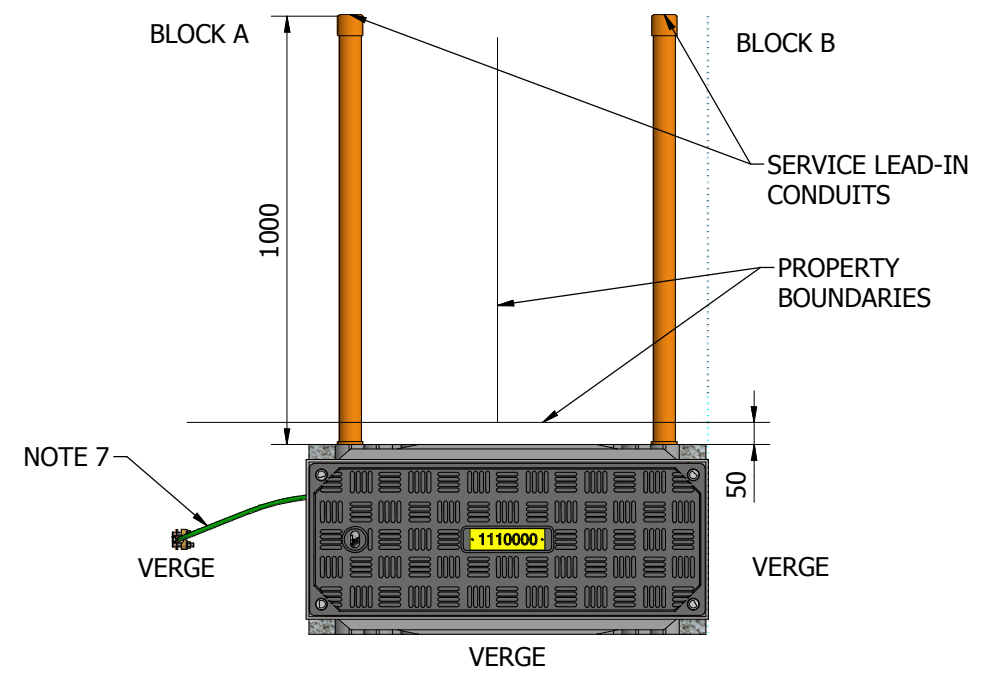

ITEM	UA TYPE	DESCRIPTION	STOCK CODE	QTY	DRAWING NO
1	P	CABLE, SDI, 16mm², CU, 7/1.72, 0.6/1kV, X-90, BLACK PVC SHEATH	1195574	AR	D102-0032
2	P	HEATSHRINK, 16/4 x 100mm FOR 16mm² CABLE, HEAVY WALL WITH ADHESIVE	1167809	AR	D103-0252
3	P	LUG, CRIMP, 16mm², COPPER, M8 BOLT HOLE, SEALED	1067369	AR	D103-0049
4	P	TIE, ZIP, NEUTRAL MARKER, BLACK, NYLON	1197433	AR	D105-0013
5	P	TIE, CABLE, 368 x 4.8mm, UV RESISTANT, BLACK, NYLON	1197400	AR	D103-0255
6	P	HEATSHRINK BANDS, 13/07 X 25MM, PHASE IDENTIFICATION, RED/WHITE/BLUE	1195420	AR	D103-0268
7	S	SA, PITS, URD SERVICE PIT, STREETLIGHT CABLE TERMINATION	-	AR	D302-0030
8	S	SA, PITS, URD SERVICE PIT BRANCH JOINT AND BELL TERMINATION	-	AR	D302-0033
9	S	SA, PITS, URD SERVICE PIT FOOTING	-	AR	D302-0016

<