


UG & OH NETWORK VEGETATION CLEARANCE REQUIREMENT AND POTENTIAL "FALL IN" VEGETATION HAZARD

OH SERVICE VEGETATION CLEARANCE REQUIREMENT AND POTENTIAL "FALL IN" VEGETATION HAZARD

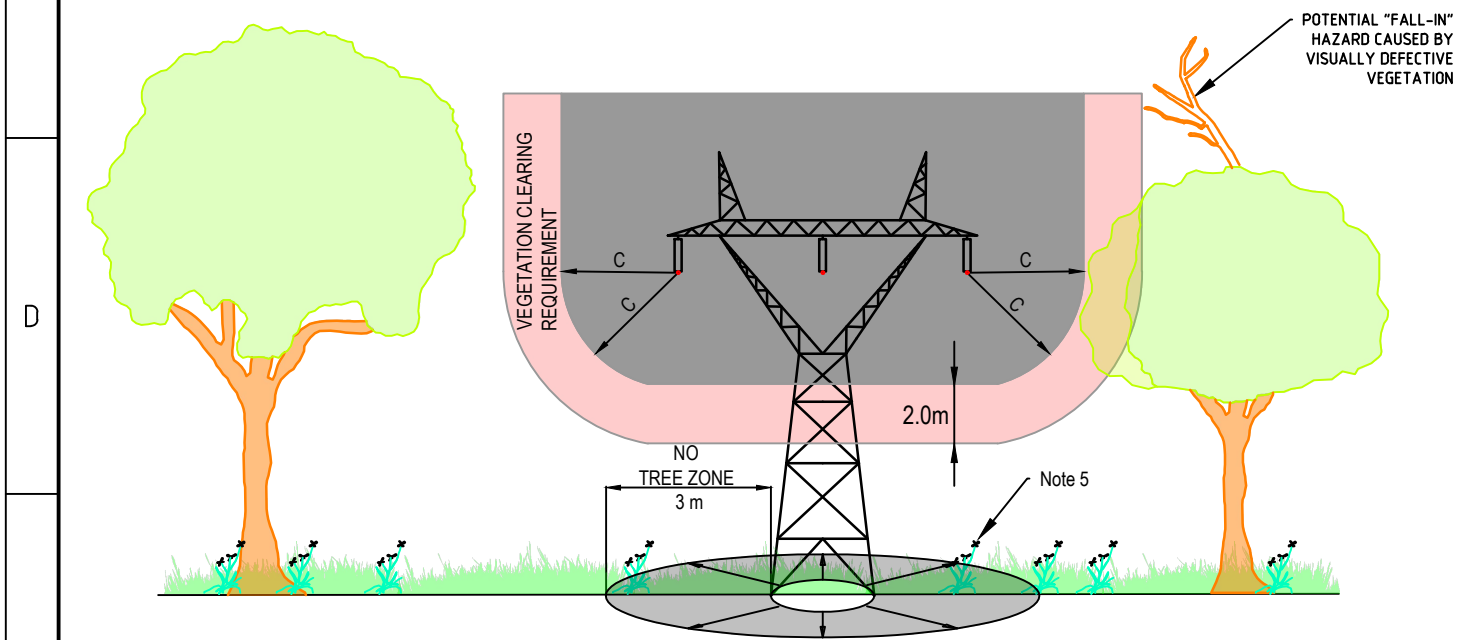

TRANSMISSION LINE VEGETATION CLEARANCE REQUIREMENT AND POTENTIAL "FALL IN" VEGETATION HAZARD

**NOTES**

1. SAG SHOULD BE CHECKED WHEN LINE IS OPERATING AT IT'S DESIGN TEMPERATURE RATING.
2. FALL IN VEGETATION THAT IS OUT SIDE THE MINIMUM CLEARANING REQUIREMENT DISTANCES FROM ELECTRICITY ASSETS MUST BE CLEARED AS FAR AS IT IS REASONABLY PRACTICABLE TO DO SO. FALL IN VEGETATION CAN BE A VISUALLY DEFECTIVE VEGETATION WHICH IS DEAD, DYING AND APPEARS STRUCTURALLY UNSOUND AS IDENTIFIED FROM THE PERSPECTIVE OF THE NETWORK ASSET, AND WHICH MAY REQUIRE PRUNING, CUTTING , OR REMOVAL TO OBLVIATE THE RISK OF IT FALLING, DROPPING, AND CONTACTING THE ASSET.
3. BRANCHES AND TREE GROWTH MUST NOT OVERHANG WITHIN THE VEGETATION CLEARANCE SPACE, AND TREES MUST BE MAINTAINED SO THAT THEY CANNOT FALL ON TO OR DROP BRANCHES ON EVOENERGY ASSETS.
4. ALL PRUNING MUST COMPLY WITH AS 4373 " PRUNING OF AMENITY TREES" .
5. WELL MAINTAINED GRASS AND SHRUBS UP TO 1m HEIGHT ARE ALLOWED IN NO TREE ZONE.

				Drawn: K. Vedanti	Designed: K. Vedanti	<b>evoenergy</b>	Scale: N.T.S	Date: 24/03/2022	Sheet No:	
				Checked: N. Azizi	29/06/2022		FALL IN HAZARDOUS VEGETATION IN ACT & NSW	Work Pack No:	File:	
				Approved: W. Cleland	29/06/2022			Status:	Current	
A	VEGETATION CLEARANCES AMENDED	30/09/2022	N. Azizi	W. Cleland			A3		3811-019	
No	Revision	Date	Checked	Approved					Rev A	

The information contained within this drawing & associated electronic file shall remain the property of Evoenergy and shall not be copied or used for any other purpose without express written permission from Evoenergy. © Evoenergy. 2018.